




NOTES

1. WALL BOXES MUST BE EARTH GROUNDED TO THE SAME GROUND OR GUARANTEE IS VOID. SYSTEM GROUND STAKES INFORMATION IS SHOWN ON INSTALLATION PRINTS.
- ② CONTROL CABLE RG-58/U, 1/4" DIAMETER. IF ANY CABLE LENGTH EXCEEDS 1000' CONTACT THE NEVCO FACTORY. CABLE VOLTAGE IS 5 VOLTS. FOR CONDUIT INSTALLATION: 1/2" CONDUIT REQUIRED
- ③ FOR ELECTRICAL POWER REQUIREMENTS OF EACH ITEM REFER TO OTHER DRAWINGS OR SPECIFICATIONS.
- ④ WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
- ⑤ CONTROL CABLE 25' W/CONNECTORS
6. LOCATE THE SCOREBOARD ON THE SOUTH OR WEST SIDE OF THE FIELD (USA) FOR PROPER DAYTIME VISIBILITY.

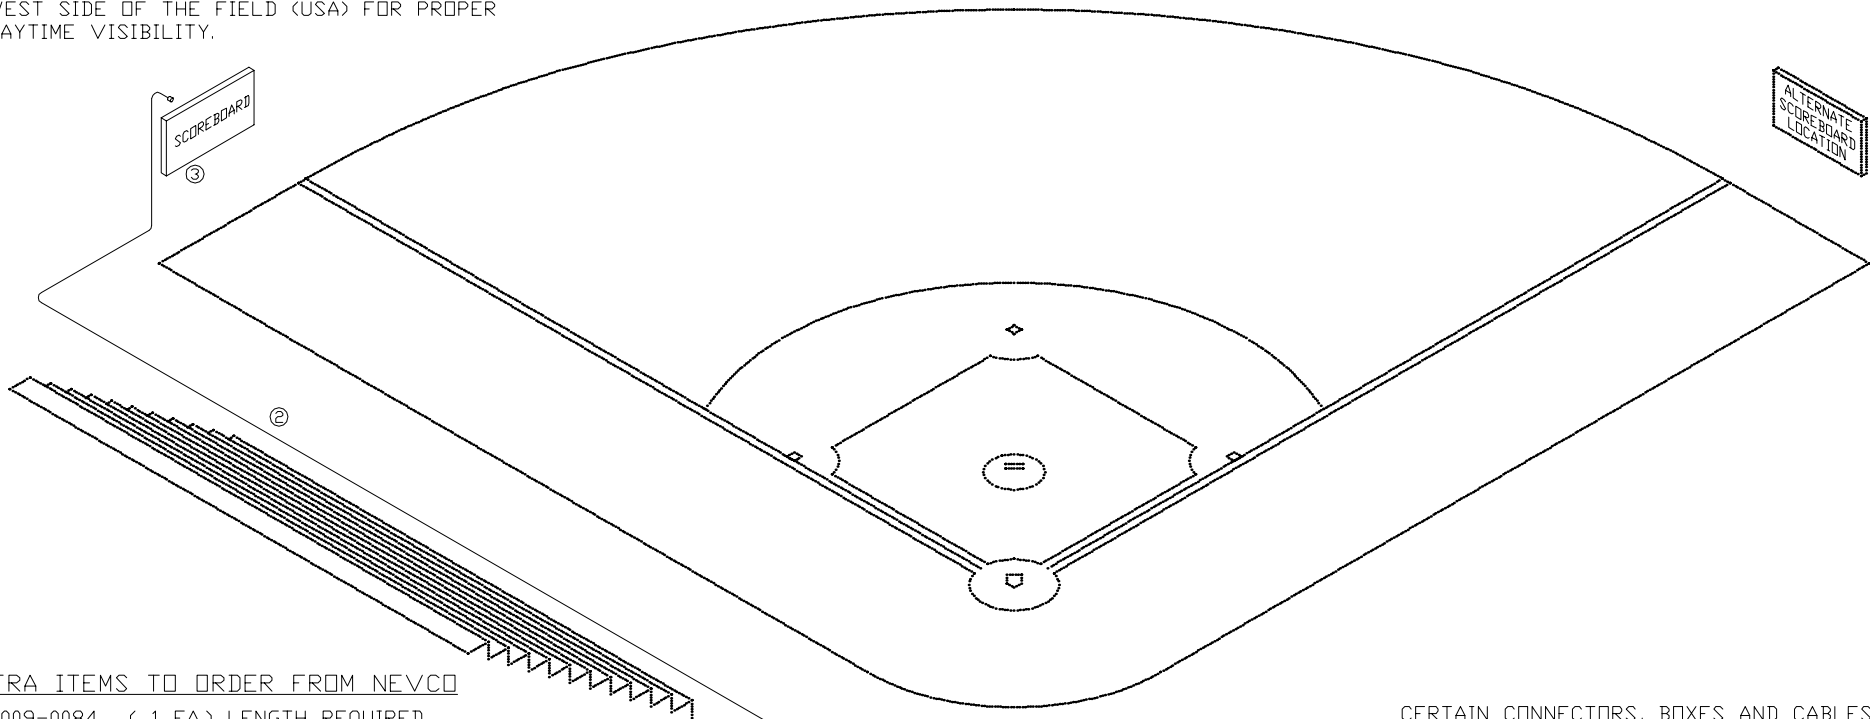


EXTRA ITEMS TO ORDER FROM NEVCO

- ② 009-0084 < 1 EA. > LENGTH REQUIRED

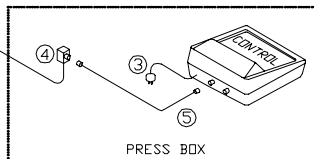

CERTAIN CONNECTORS, BOXES AND CABLES ARE FURNISHED WITH THE EQUIPMENT SHOWN. ONLY THE "EXTRA ITEMS" ARE NEEDED TO COMPLETE THIS SYSTEM.

BASEBALL SINGLE SCOREBOARD SYSTEM	 NEVCO SCOREBOARD CO. GREENVILLE, ILLINOIS 62246
	DRAWING NO. C5901
DRAWN HW	DATE 6/16/92
SHEET 1 OF 1	