
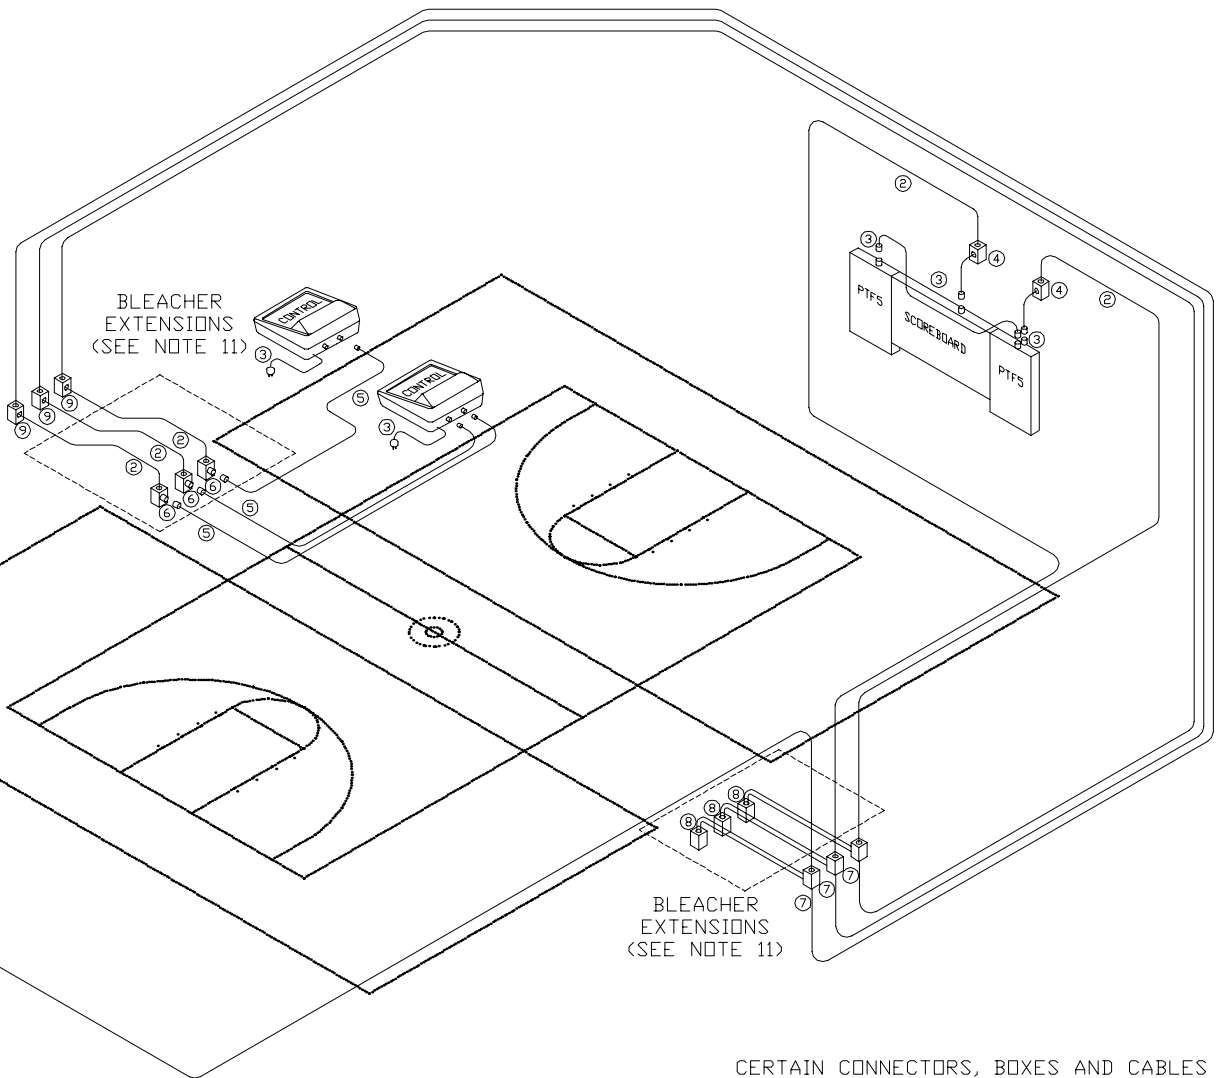







NOTES

1. WALL BOXES MUST BE EARTH GROUNDED TO THE SAME GROUND OR GUARANTEE IS VOID.
2. CONTROL CABLE RG-58/U, 1/4" DIAMETER. IF ANY CABLE LENGTH EXCEEDS 500' CONTACT THE NEVCO FACTORY. CABLE VOLTAGE IS 5 VOLTS. FOR CONDUIT INSTALLATION: 1/2" CONDUIT REQUIRED
3. FOR ELECTRICAL POWER REQUIREMENTS OF EACH ITEM REFER TO OTHER DRAWINGS OR SPECIFICATIONS.
4. WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
5. CONTROL CABLE 25' W/CONNECTORS
6. WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
7. WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
8. WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
9. WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
10. TERMINATED "T" CONNECTOR
11. INSTEAD OF BLEACHER EXTENSIONS NEVCO RECOMMENDS LONGER CONTROL CABLES (ITEM 5) OR USE OF FLOOR BOXES.




EXTRA ITEMS TO ORDER FROM NEVCO

- 2 009-0084 (6 EA.) LENGTHS REQUIRED
- 7 239-0074 (3 EA.)
- 8 239-0081 (3 EA.)
- 9 239-0074 (3 EA.)
- 10 210-0007 (3 EA.)
- 210-0008 (6 EA.) 2-WIRE (BNC) CONNECTOR



CERTAIN CONNECTORS, BOXES AND CABLES ARE FURNISHED WITH THE EQUIPMENT SHOWN. ONLY THE "EXTRA ITEMS" ARE NEEDED TO COMPLETE THIS SYSTEM.

BASKETBALL DUAL SCOREBOARDS, PTF5 PANEL SETS, W/ALT. CONTROL POINTS & BLEACHER EXTENSIONS SYSTEM		 NEVCO SCOREBOARD CO. GREENVILLE, ILLINOIS 62246
DRAWN BMK	DATE 3/24/03	

DRAWING NO. C9042