



NOTES

1. WALL BOXES MUST BE EARTH GROUNDED TO THE SAME GROUND OR GUARANTEE IS VOID. SYSTEM GROUND STAKES INFORMATION IS SHOWN ON INSTALLATION PRINTS.
- ② CONTROL CABLE RG-58/U, 1/4" DIAMETER. IF ANY CABLE LENGTH EXCEEDS 1000' CONTACT THE NEVCO FACTORY. CABLE VOLTAGE IS 5 VOLTS. FOR CONDUIT INSTALLATION: 1/2" CONDUIT REQUIRED
- ③ FOR ELECTRICAL POWER REQUIREMENTS OF EACH ITEM REFER TO OTHER DRAWINGS OR SPECIFICATIONS.
- ④ WALL BOX 4" x 2 1/8" x 2 1/8" W/COVER
- ⑤ CONTROL CABLE 25' W/CONNECTORS
6. LOCATE THE SCOREBOARD ON THE SOUTH OR WEST SIDE OF THE FIELD (USA) FOR PROPER DAYTIME VISIBILITY.

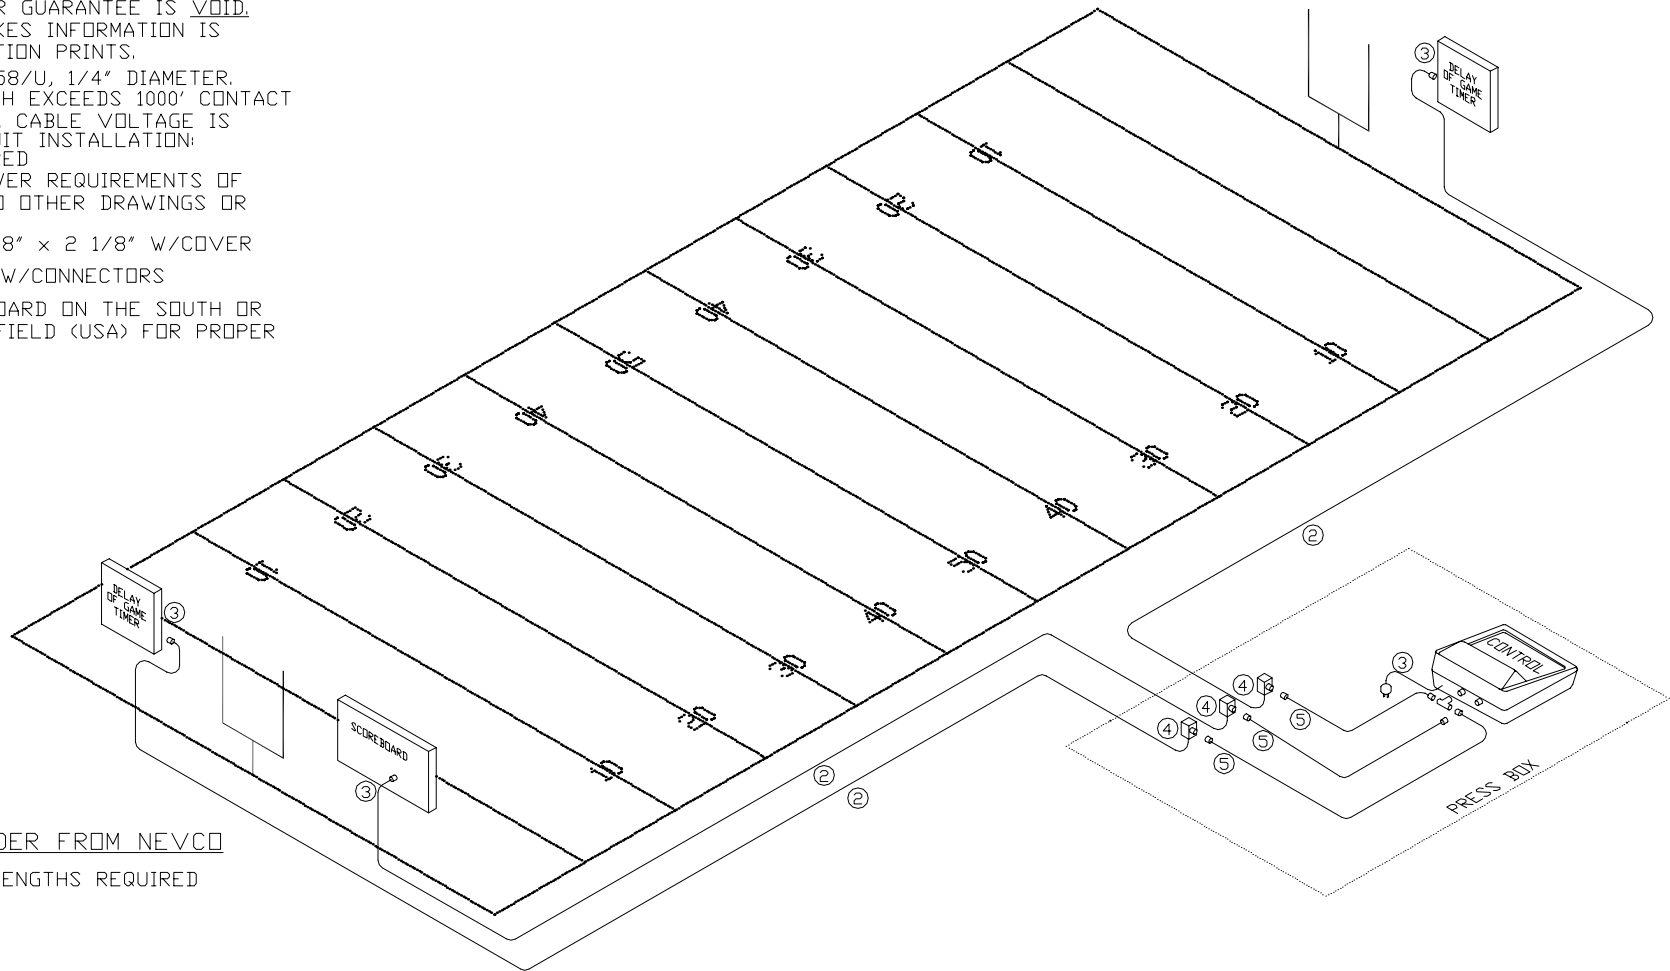


EXTRA ITEMS TO ORDER FROM NEVCO

- ② 009-0084 ( 3 EA.) LENGTHS REQUIRED



CERTAIN CONNECTORS, BOXES AND CABLES ARE FURNISHED WITH THE EQUIPMENT SHOWN. ONLY THE "EXTRA ITEMS" ARE NEEDED TO COMPLETE THIS SYSTEM.

FOOTBALL SINGLE SCOREBOARD & DGT SET SYSTEM		 NEVCO SCOREBOARD CO. GREENVILLE, ILLINOIS 62246	
		DRAWING NO. C5869	
DRAWN HW	DATE 4/2/92	SHEET 1 OF 1	